
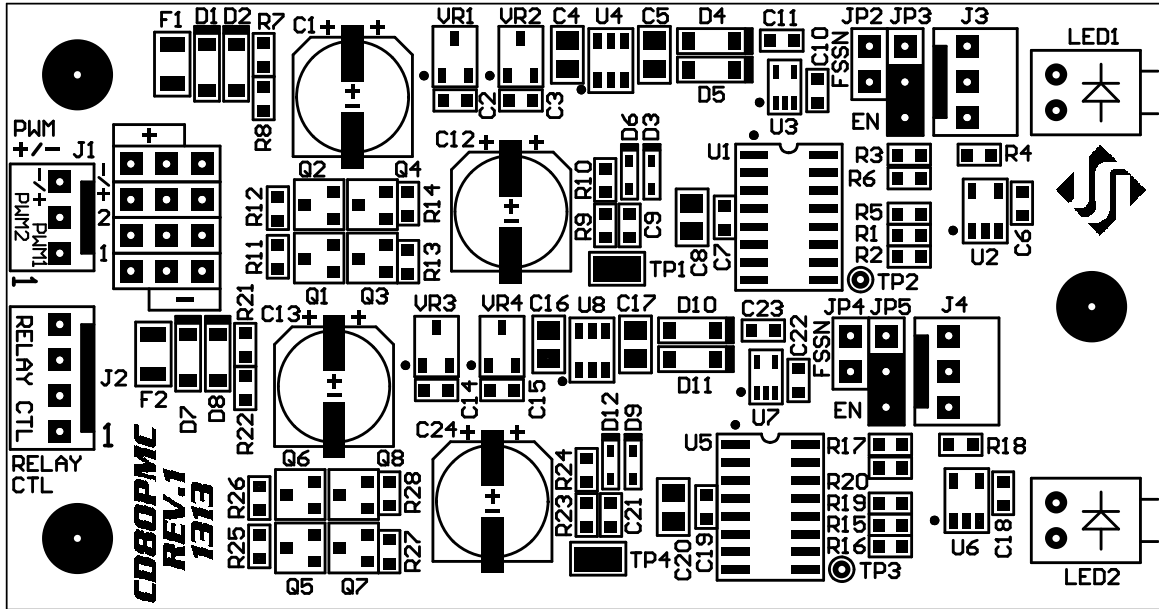


CD80PMC

JP3 AND JP5 JUMPERS
SELECT ENABLE OR DISABLE
RELAY CONTROL VIA PWM INPUT

FACTORY SET TO ENABLE



MOVE JUMPER(S) TO DISABLE

